


ELEVATION VIEW
NOT TO SCALE

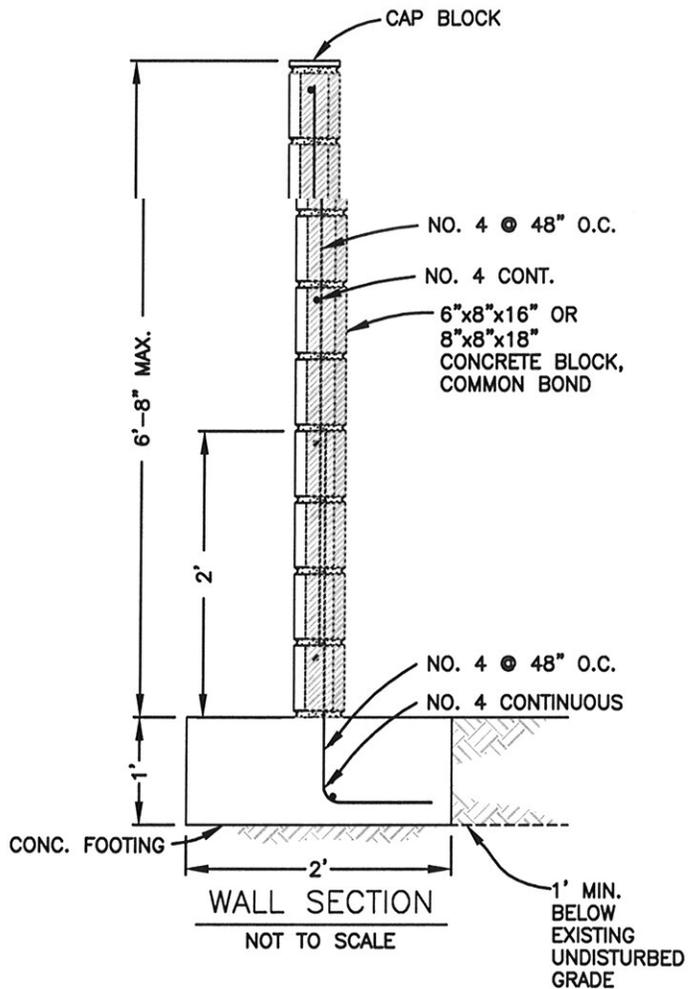

WALL SECTION
NOT TO SCALE

NOTE:

1. LATEST EDITION OF THE CBC SHALL BE COMPLIED WITH.
2. WALL THICKNESS SHALL BE EITHER 6" OR 8".
3. GROUT TO BE PLACED AT LOCATION OF VERTICAL REINFORCING BARS.
4. MORTAR SHALL CONSIST OF PORTLAND CEMENT AND SAND MEETING TYPE "S" REQUIREMENTS AS PER LATEST ADOPTED BUILDING CODE.

CITY of CORCORAN • Department of Public Works

Standard Drawing for:

**NON-DECORATIVE
BLOCK FENCE**

APPROVED:  City Engineer

05/19/08
Date

Revised:

M-12