


NOTE:

THE VALLEY GUTTER SHALL HAVE A MIN. NET SLOPE OF 0.0030 IN THE DIRECTION OF FLOW.

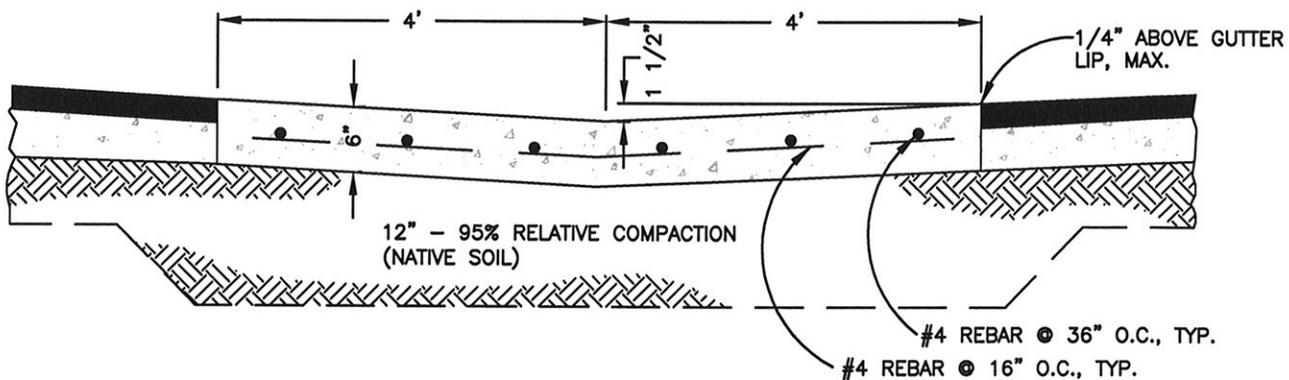

SECTION A-A
NOT TO SCALE

NOTES:

1. SEE CONCRETE NOTES AND CITY STANDARD SPECIFICATIONS.
2. CONCRETE SHALL BE MINIMUM SIX SACK MIX. (3250 P.S.I. MIN. IN 28 DAYS).

CITY of CORCORAN • Department of Public Works

Standard Drawing for:

VALLEY GUTTER

APPROVED: City Engineer

05/19/08
Date

Revised:

C-5