




BENDS
NOT TO SCALE




SECTION A - A

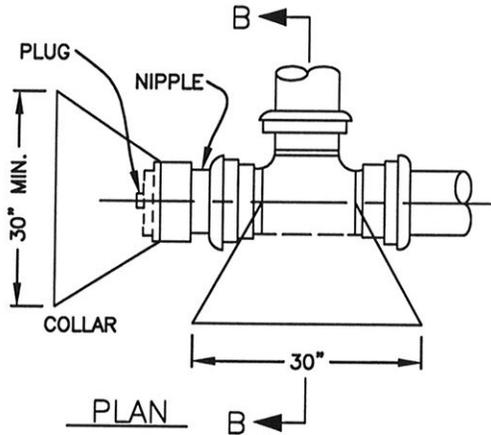


TEES & PLUGS
NOT TO SCALE

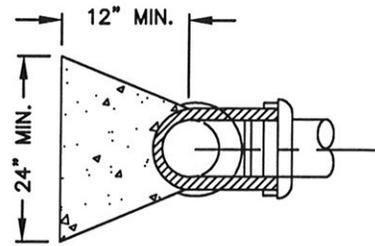

SECTION B - B

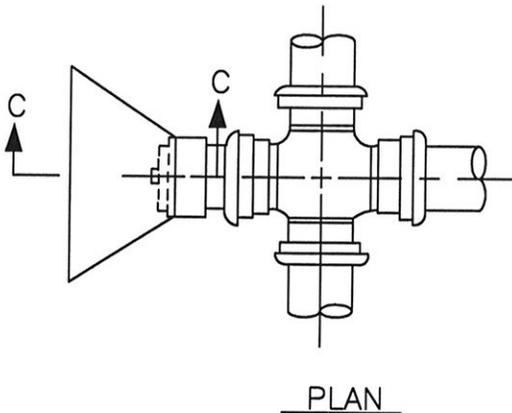

PLUGGED CROSSES
NOT TO SCALE



CONCRETE FIVE SACK
MIX (2500 P.S.I. MIN.
IN 28 DAYS).

SECTION C - C

NOTE:

THRUST BLOCKS ACCORDING TO PIPE MANUFACTURER
INSTALLATION GUIDE AND APPROVAL OF CITY ENGINEER.

CITY of CORCORAN • Department of Public Works

Standard Drawing for:

CONCRETE THRUST BLOCKS

APPROVED:  City Engineer

05/19/08
Date

Revised:

W-4