

ADDENDUM NUMBER 1

FOR THE

CITY OF CORCORAN

**2020 MICRO-SURFACING & STREET
IMPROVEMENTS PROJECT**

September 3, 2020



OWNER:
City of Corcoran
832 Whitley Avenue
Corcoran, CA 93212
(559) 992-2151

PREPARED BY:
A&M
310 W Murray Avenue
Visalia, CA 93291
(559) 429-4747

ADDENDUM NUMBER 1

The following addition, deletions, or modifications shall become part of the Contract Documents for the City of Corcoran 2020 Micro-surfacing & Street Improvements project:

REVISIONS TO SPECIFICATIONS:

ITEM No. 1 REVISION TO FRONT END DOCUMENTS

- Page 99, “EXHIBIT 15 H – DBE INFORMATION – GOOD FAITH EFFORTS” from documents released on August 17, 2020 named “NOTICE TO CONTRACTORS AND SPECIAL PROVISIONS FOR 2020 MICRO-SURFACING & STREET IMPROVEMENTS” shall be replaced with the “EXHIBIT 15 H – DBE INFORMATION – GOOD FAITH EFFORTS” released on September 3, 2020 in Addendum Number 1.
- Page 99, “EXHIBIT 15 H – DBE INFORMATION – GOOD FAITH EFFORTS” has been revised from “...Disadvantaged Business Enterprise (DBE) goal of 4%...” to state “...Disadvantaged Business Enterprise (DBE) goal of **15%**...”

REVISIONS TO DRAWINGS:

ITEM No. 1 CHAIN LINK FENCE DETAIL AND CHAIN LINK GATE DETAIL

- City Standards M-10 and M-11 shown on the plans (Sheet 9) have been revised from “GALVANIZED CHAINLINK, 2” MASH, 2 GAUGE.” to “GALVANIZED CHAINLINK, 2” MESH, 9 GAUGE.”

CONTRACTOR QUESTIONS:


Q1: Sheet 9 shows City Standard Details for Chain Link Fencing M-10 and M-11. Both note chain link “2-inch mash, 2 gauge” should this be “2-inch mesh, 9 gauge”?

A1: Yes, the City Standard for Chain-link Fencing will be Galvanized Chain-link 2-inch mesh, 9 gauge.

--


Q2: On the on Page 1 it states the DBE contract goal for the project is 15% however on Page 99 it states the DBE contract goal is 4%, can you clarify which one it is?

A2: The DBE contract goal for this project is 15%.

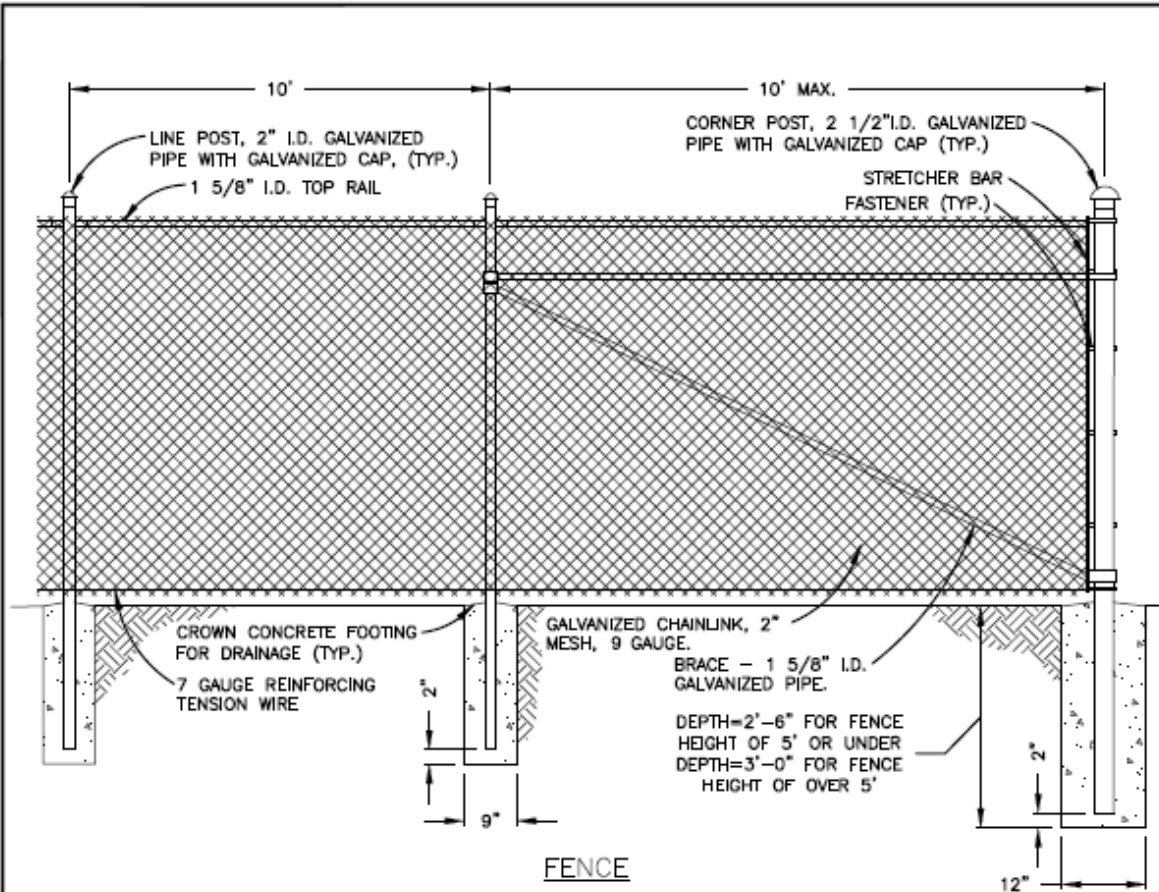

NOTES:

1. DEPTH OF FOOTINGS ARE INTO NATURAL UNDISTURBED SOIL OR TESTED OR APPROVED COMPACTED FILL.
2. CONCRETE FOOTINGS SHALL BE A MIN. FIVE SACK MIX. (3200 P.S.I. MIN. IN 28 DAYS).
3. THE FOLLOWING ITEMS SHALL BE FURNISHED & INSTALLED ONLY WHEN SHOWN ON PLANS AND/OR CALLED FOR IN THE SPECIAL PROVISIONS:
 - A. BARBED WIRE
 - B. EXTENTION ARM
 - C. TOP RAIL
 - D. VINYL SLATS
4. 9 GAUGE WIRE FASTENERS SHALL BE USED.
5. DETAIL 'A' REFERS TO ALL PUBLIC ENCLOSURES UNLESS SPECIFICALLY NOTED OTHERWISE.
6. WHEN FENCE IS AROUND A DRAINAGE BASIN A 6" w x 8" d CONCRETE CURB SHALL BE POURED UNDER FENCE, FLUSH WITH BOTTOM OF FENCE FABRIC.
7. WHERE SLATS ARE CALLED FOR ON PLANS, ALL LINE POSTS SHALL BE 2-3/8" O.D. SCH. 40 PIPE.
8. INSTALLATION OF BARBED WIRE REQUIRES CITY APPROVAL PRIOR TO INSTALLATION.

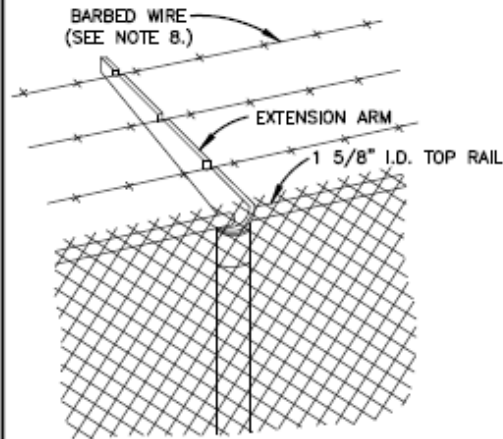

DETAIL A

CITY of CORCORAN • Department of Public Works


Standard Drawing for:

**CHAIN LINK FENCE
DETAILS**

APPROVED BY: *[Signature]* 03/01/17
City Engineer R.C.E. 53350 Date

Revised:

M-10

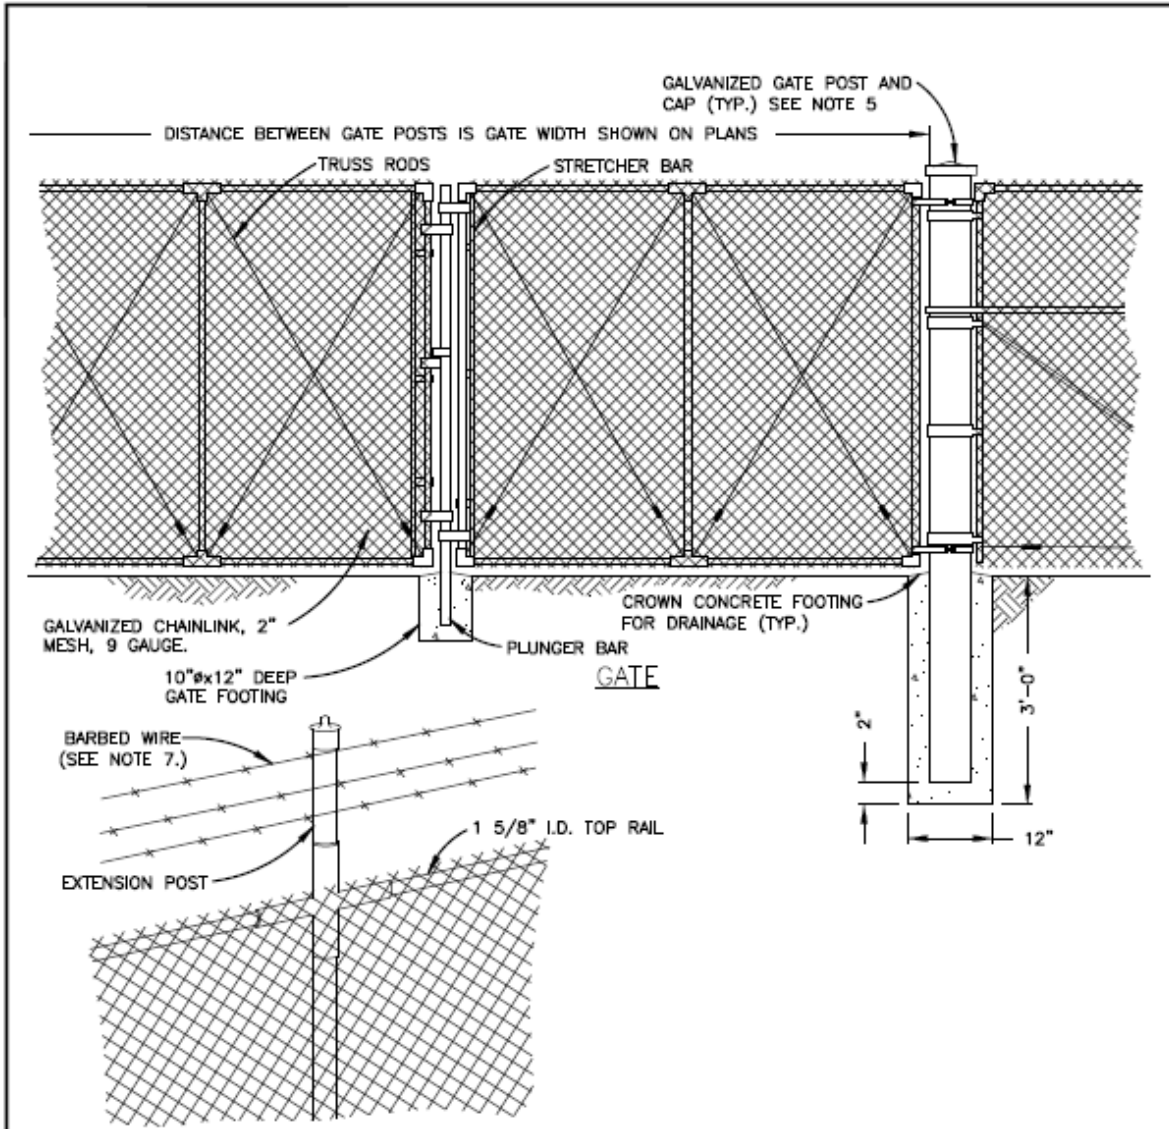

DETAIL A

NOTES:

1. DEPTH OF FOOTINGS ARE INTO UNDISTURBED SOIL OR TESTED AND APPROVED COMPACTED FILL.
2. CONCRETE FOOTINGS SHALL BE A MIN. 5 SACK MIX AND TEST TO A MIN. OF 3200 P.S.I. IN 28 DAYS.
3. THE FOLLOWING ITEMS SHALL BE FURNISHED AND INSTALLED ONLY WHEN SHOWN ON PLANS AND/OR CALLED FOR IN THE SPECIAL PROVISIONS:
 - A. BARBED WIRE
 - B. EXTENSION ARM
4. 12 GAUGE WIRE FASTENERS SHALL BE USED.
5. GATE POSTS - USE 2 1/2" I.D. PIPE FOR DOUBLE GATE WIDTHS UP TO 12' AND 4" I.D. PIPE FOR DOUBLE GATE WIDTHS 12' TO 24'.
6. DETAIL 'A' REFERS TO ALL PUBLIC ENCLOSURES UNLESS SPECIFICALLY NOTED OTHERWISE.
7. INSTALLATION OF BARBED WIRE REQUIRES CITY APPROVAL PRIOR TO INSTALLATION.

CITY of CORCORAN • Department of Public Works

Standard Drawing for:

**CHAIN LINK GATE
DETAILS**

APPROVED BY:  03/01/17

City Engineer R.C.E. 53350 Date

Revised:

M-11

NOTE: One copy of this Addendum Number 1 shall be signed by the Contractor and must be submitted with the bid as acknowledgement of receipt and the acceptance of this Addendum Number 1.

Prepared by:  9/3/2020
Orfil Muniz, P.E. Date
A&M Consulting Engineers

Accepted by: _____
Contractor (signature) Date